


# CONCRETE FOUNDATIONS

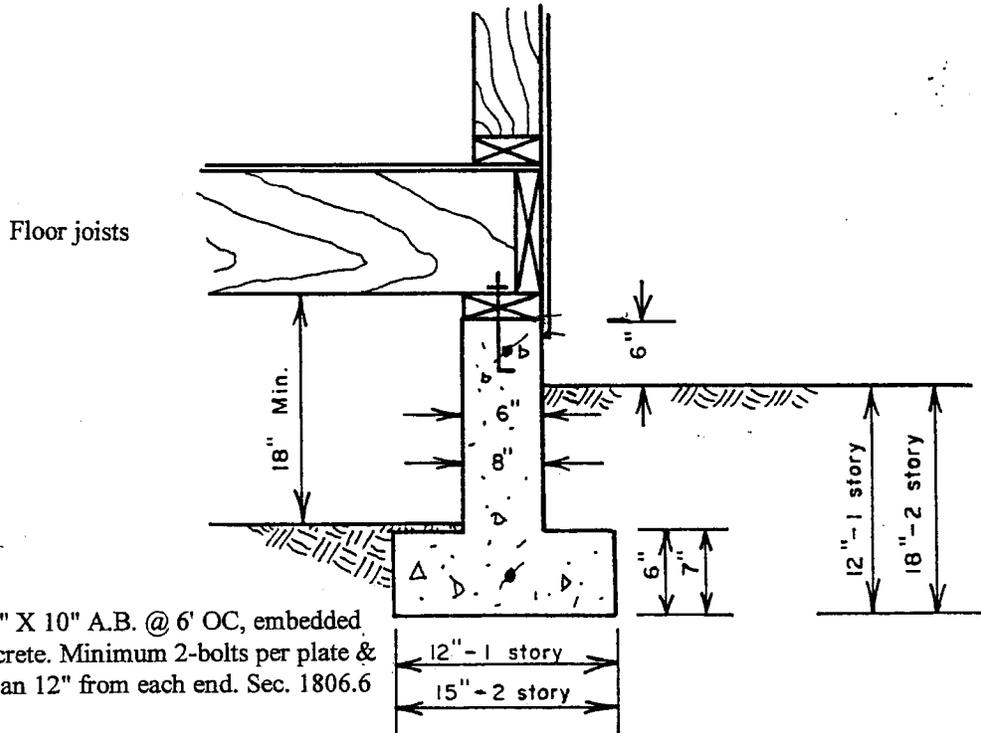


Provide 5/8" X 10" A.B. @ 6' OC, embedded 7" into concrete. Minimum 2-bolts per plate & not more than 12" from each end. Sec. 1806.6

Provide @ each bolt a 2" X 2" X 3/16" plate washer. Section 1806.1

Foundation plates & sills shall be of foundation grade redwood, foundation cedar #2, or approved pressure-treated fir, all plates & sills shall be identifiable by a grade stamp. Sec. 2306.4

Provide 1 #4 reinforcement bar, top & bottom of footing/ stem wall. Section 1806.7

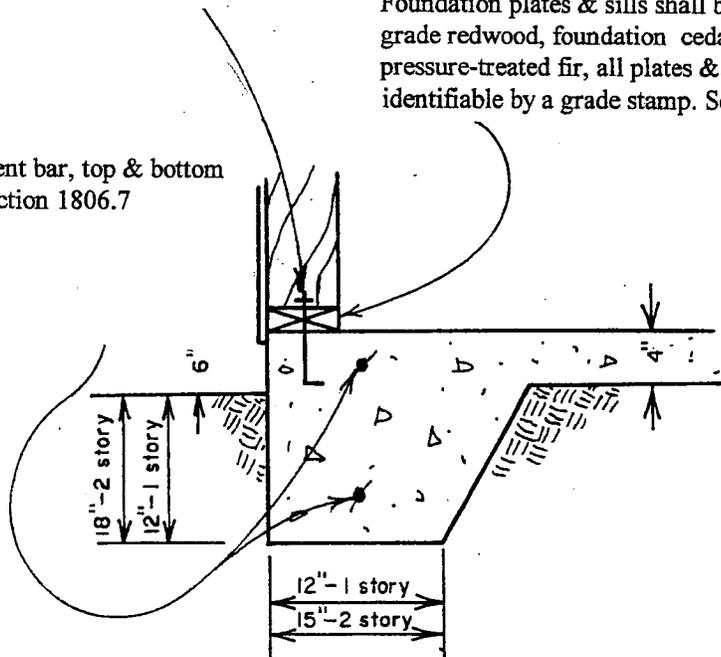

**INSPECTION SERVICES DIVISION  
CITY of EUREKA**

I.S. STD. \_\_\_\_\_  
 DATE 8-30-76  
 REVISED OCTOBER 7, 1999  
 APPROVED \_\_\_\_\_